


## Kongres Container

# Installation of battery cabinet in communication network cabinet

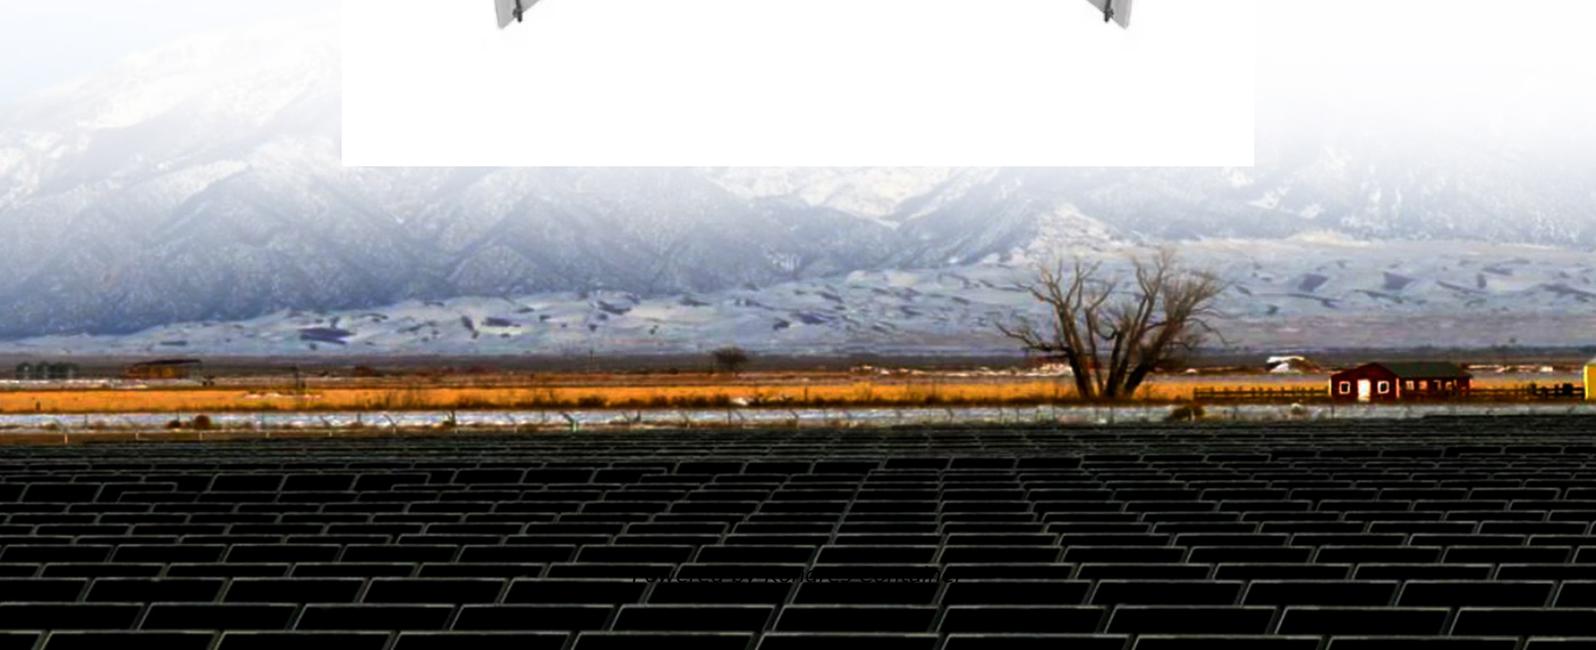

## Overview

---

How do I connect a battery cabinet to an ups?

In systems with more battery cabinets, only the system BMS of battery cabinet 1 (the battery cabinet closest to the UPS) is connected to the UPS. Remove signal cable 0W13441 between the SMPS I/O port and the DRY CONTACT ports on battery cabinet 2 and battery cabinet 3. • SG IO 1: Used for sending signals for minor and major alarms to the UPS.

What are the safety requirements for a battery cabinet?

- The battery cabinet must be properly earthed/grounded and due to a high leakage current, the earthing/grounding conductor must be connected first. Failure to follow these instructions will result in death or serious injury. Battery Safety DANGER.

How many battery cabinets can a Lib 25 m cable supply?

LIBSEOPT001 Galaxy LIB 25 m communication cable kit 1 990-91430E-001 17 Overview of Accessory Kits With 10, 13, 16, or 17 Battery Modules 1. One AC/DC converter box can supply up to 10 battery cabinets. For 11+ battery cabinets, at least two AC/DC converter boxes are required. 2. Install one data log kit for each battery system.

Why is a network cabinet system important?

Adhering to Electrical Safety Standards Properly installing and setting up a network cabinet system is crucial for maintaining an efficient and well-organized network infrastructure.

How many battery cabinets can one AC/DC converter box supply?

1. One AC/DC converter box can supply up to 10 battery cabinets. For 11+ battery cabinets, at least two AC/DC converter boxes are required. 2. Install one data log kit for each battery system. Installation Procedure 1. Prepare for Installation, page 19. 2. Install the Rear Seismic Anchoring, page 21. 3.

How do I reinstall a battery cabinet?

Perform the following steps on all battery cabinets in the battery solution. a. Remove the cover in front of the start-up button and push the start-up button.

- The PSU2 LED and the POWER LED will turn on.
- The ABNORMAL and ALARM LEDs should remain off.

b. Reinstall the cover in front of the start-up button.

## Installation of battery cabinet in communication network cabinet

---

### Contact Us

---

For catalog requests, pricing, or partnerships, please visit:  
<https://drugiswiatowykongrespolakow.pl>